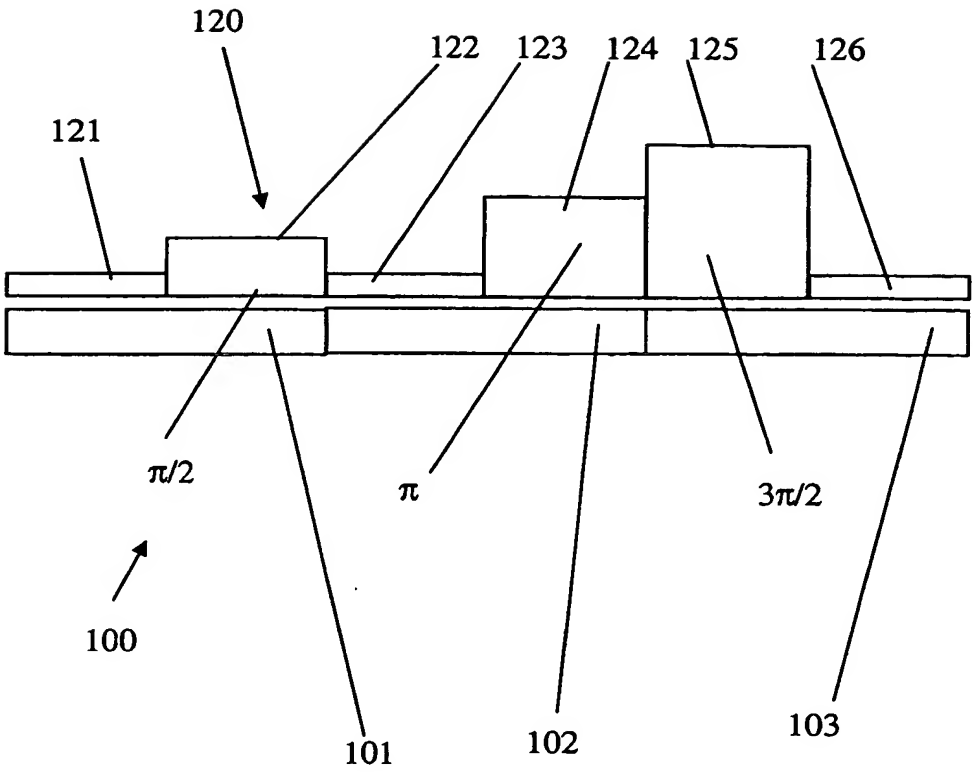

Figure 1

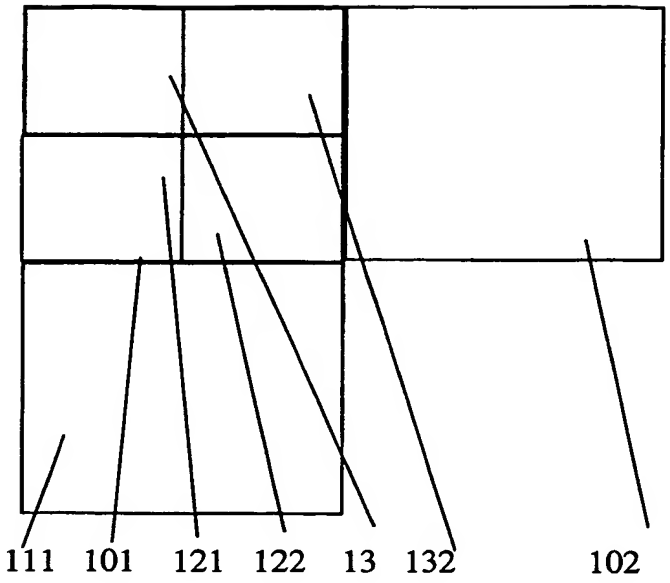

Figure 2

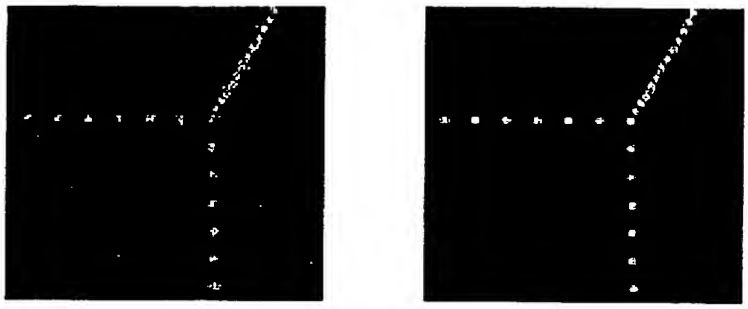

Figure 3

BEST AVAILABLE COPY

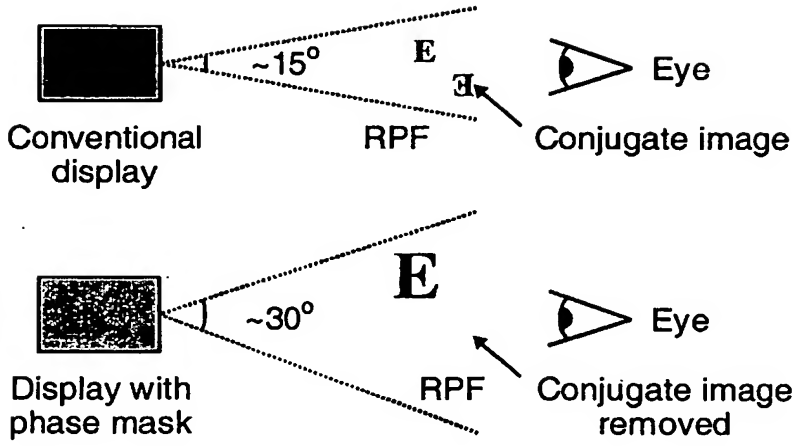
~15°
E
Eye
Conventional display
RPF
Conjugate image
E
~30°
Eye
Display with phase mask
RPF
Conjugate image removed

Figure 4

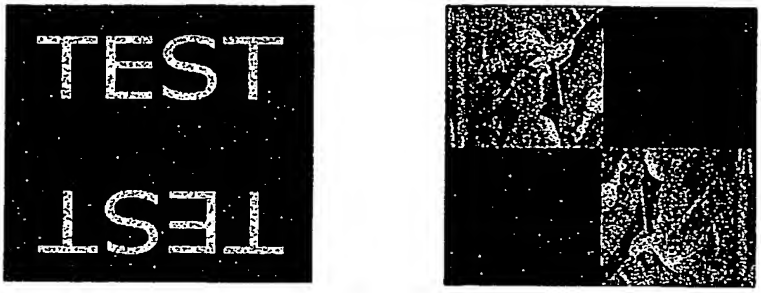

Figure 5

BEST AVAILABLE COPY